


Tank #	Product	Shell Capacity (Gallons)
1	No. 2 Fuel Oil	1,261,008
2	Out of Service	3,414,600
3	No. 4 Fuel Oil	3,396,960
8	Diesel Fuel	2,345,742
10	Out of Service	2,019
11	Fuel Oil Additive	220
12	Fuel Oil Additive	220
13	Fuel Oil Additive	350
14	Fuel Oil Additive	350

Secondary Containment System	Capacity (Gallons)
Containment Area "A" (Tank 1)	1,635,354
Containment Area "B" (Tank 2)	3,528,546
Containment Area "C" (Tank 3)	3,528,546
Containment Area "D" (Tank 8)	2,580,316
Tanks 11 & 12	16,220
Tanks 13 & 14	484

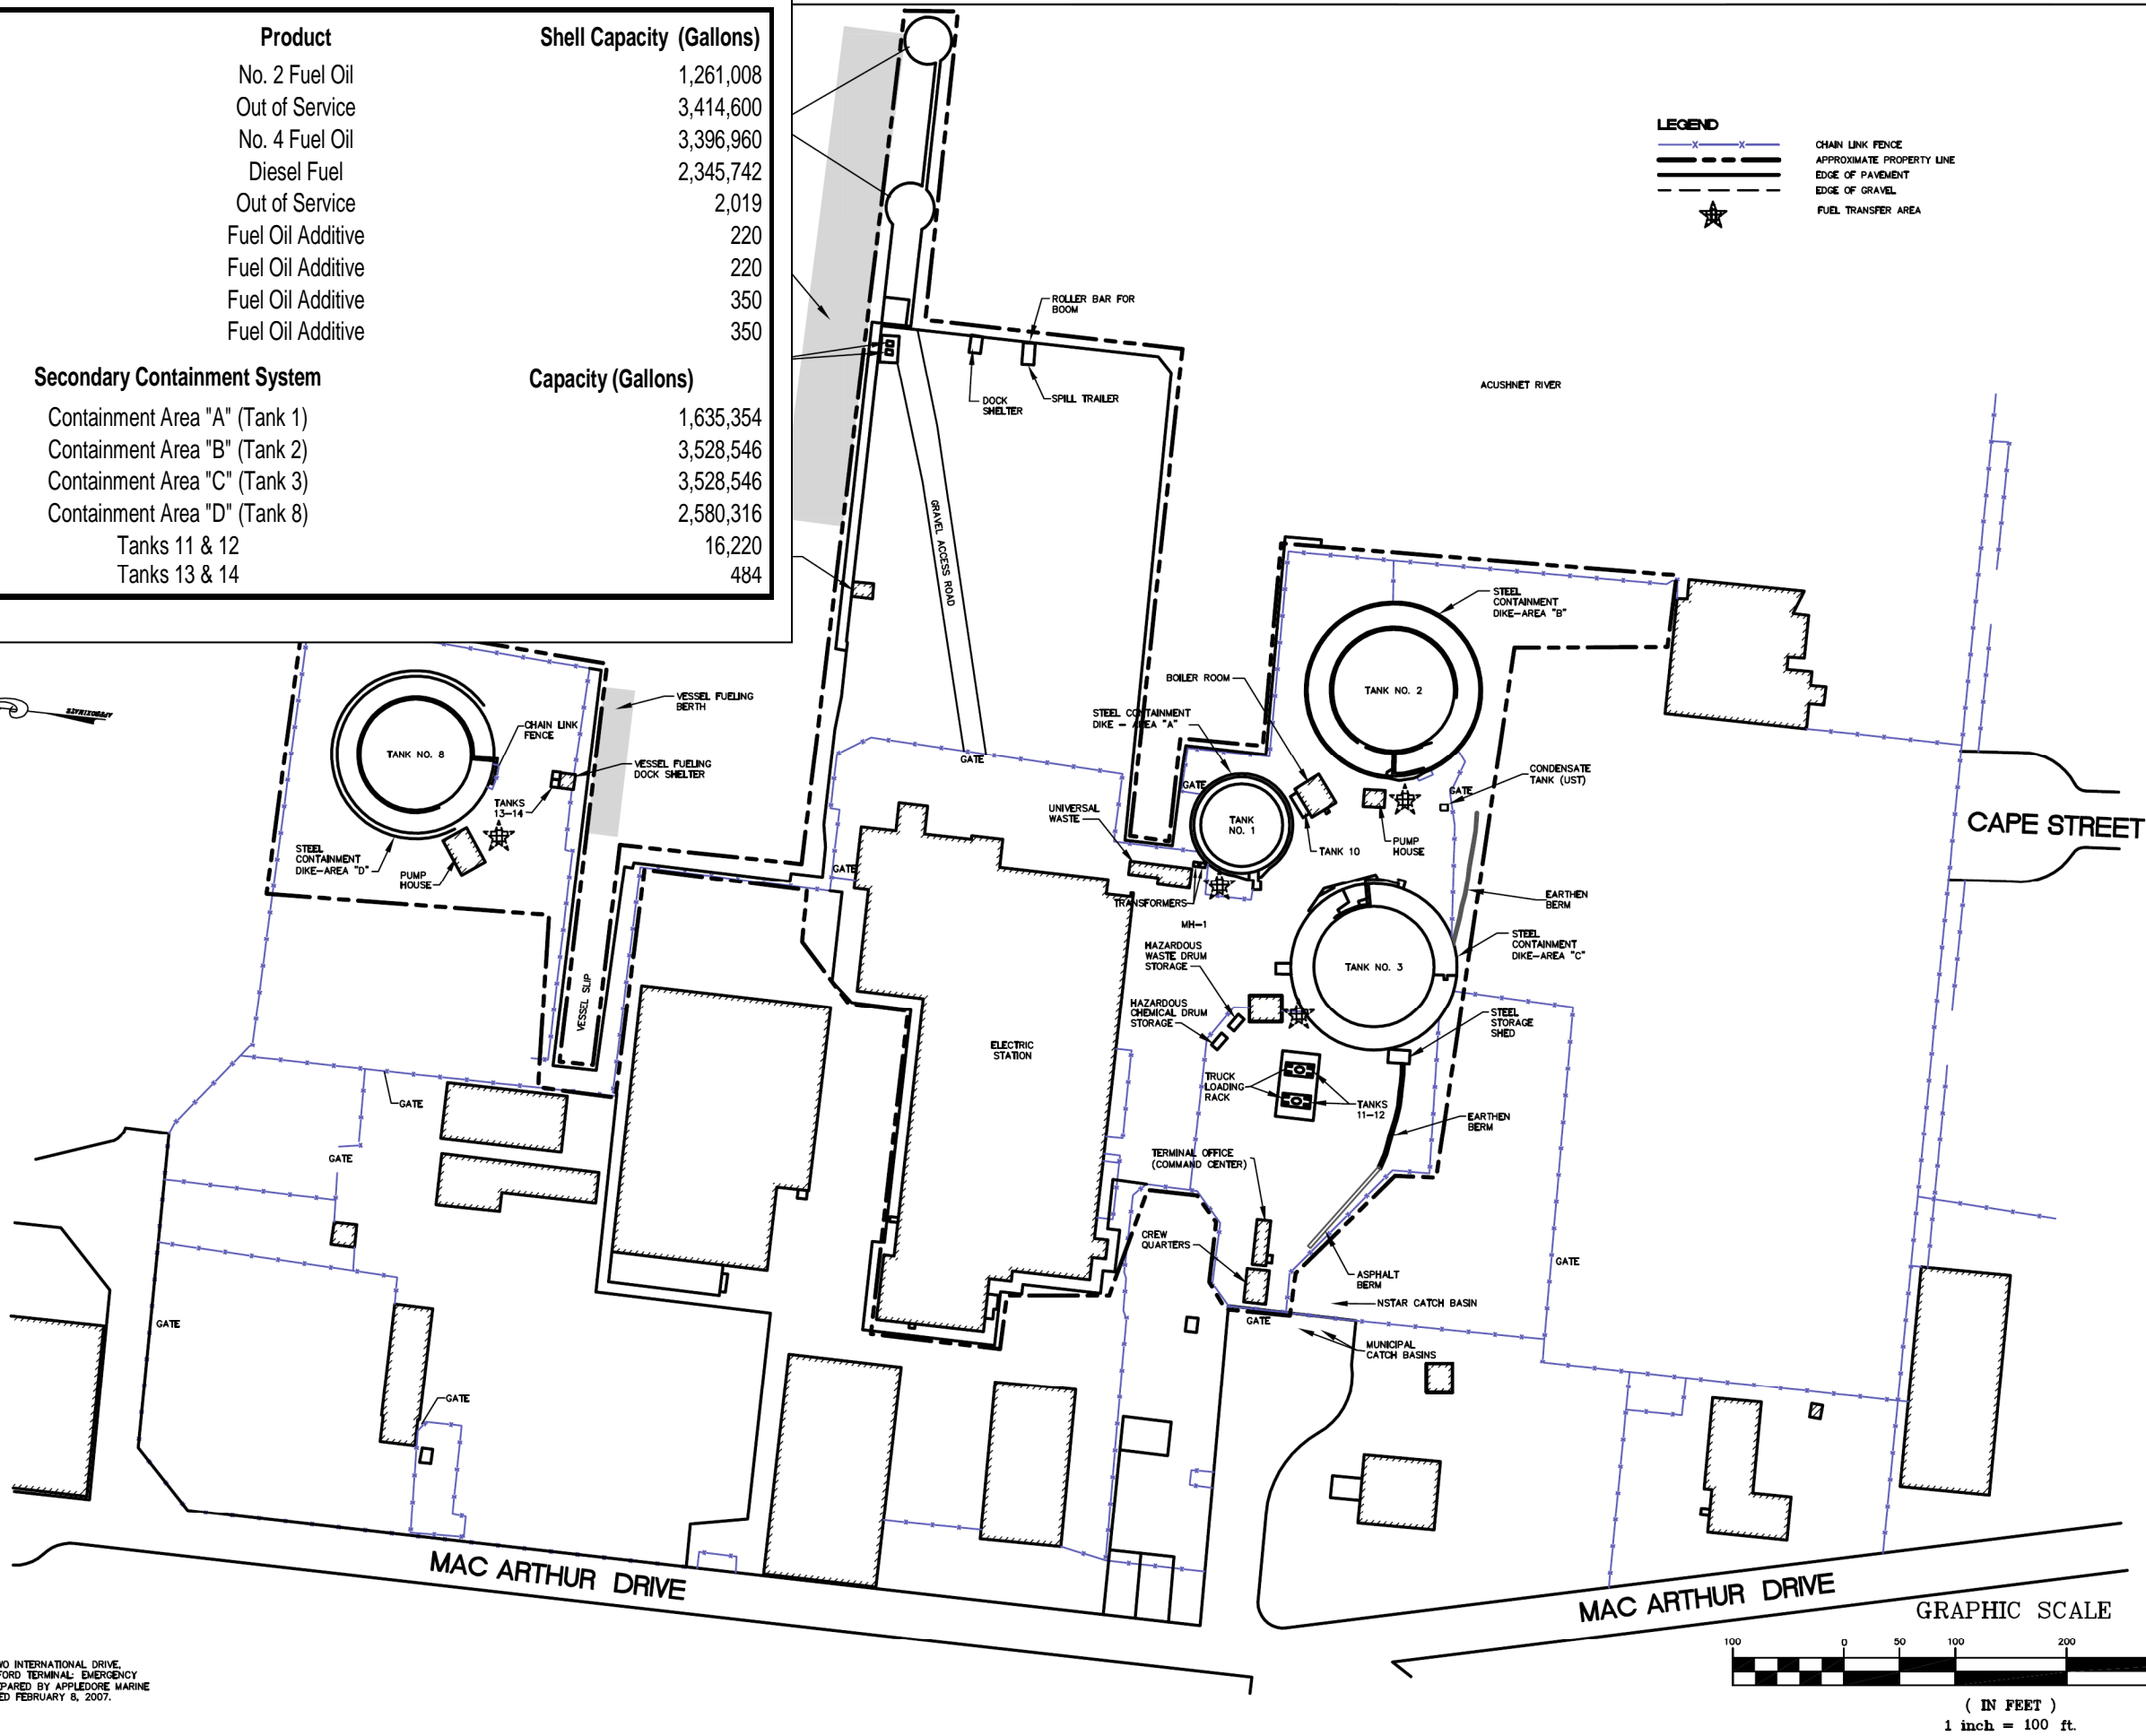

PLAN REFERENCE
 "SPRAGUE ENERGY CORP. TWO INTERNATIONAL DRIVE, PORTSMOUTH, NH, NEW BEDFORD TERMINAL: EMERGENCY RESPONSE PLAN," PLAN PREPARED BY APPLIED/RE MARINE ENGINEERING INC. PLAN DATED FEBRUARY 8, 2007.

C.E.S. ENGINEERS - SURVEYORS
 400 S. Main Street, P.O. Box 524, Portsmouth, NH 03801 Tel: 203-288-4411
 9 North Main Street, P.O. Box 1100, Southport, ME 04086 Tel: 207-244-0000 Fax: 207-244-0009
 240 Main Street, P.O. Box 187, Penikese, MA 01970 Tel: 207-764-4012 Fax: 207-764-4014

OWNER	SPRAGUE ENERGY
PROJECT	TWO INTERNATIONAL DRIVE, PORTSMOUTH, NH
SHEET NO.	NEW BEDFORD TERMINAL
DATE	09/05/07
DESIGNED BY	
CHECKED BY	
APPROVED BY	
JOB NUMBER	5019.1
DRAWING NUMBER	

HORIZONTAL SCALE

VERTICAL SCALE

DATE 09/05/07

DRAWN BY

DESIGNED BY

CHECKED BY

APPROVED BY

JOB NUMBER 5019.1

DRAWING NUMBER